

CITY OF KANSAS CITY, MISSOURI
SUPPLEMENT NO. 6
TO APWA STANDARD SPECIFICATIONS AND DESIGN CRITERIA
DIVISION II, SECTION 2200, PAVING

The following additions, deletions, and/or revisions shall become a part of the adopted standard specification:

2205 ASPHALTIC CONCRETE SURFACE AND BASE

2205.8.D The following shall be added immediately following paragraph 2205.8.D.9

2205.8.D.10 *Opening to Traffic: Traffic shall not be allowed to drive on the asphalt until the pavement temperature is at or below 170° F.*

2208 PORTLAND CEMENT CONCRETE PAVEMENT

2208.2.A Paragraph 2208.2.A shall be revised to read:

2208.2.A **A. Concrete Control and Quality:** The current editions of the "Bulletins" and Approved Sections of the "Standard Concrete Specifications" issued by the Mid-West Concrete Industry Board, Inc. (MCIB) are made a part hereof by reference. However, when the provisions of this Specification differ from the provisions of such "Bulletins" and "Sections" the provisions of this Specification shall govern.

During concrete placement, if more than 100 cubic yards is to be placed in a single day, the contractor shall supply a water tank to cure all test cylinders in for the first 24 hours after the pour. The tanks shall be of sufficient size to hold three 6"X12" cylinders for every 50 cubic yards poured that day and to allow for the water to maintain a temperature between 60°F and 80°F after being filled with water from the ready mix delivery trucks. The contractor shall be responsible for protecting persons from entering the tanks.

B. Concrete:

1. Concrete shall conform to MCIB Section 1 shall be MCIB Mix No. A658-1-2-.365 or No. WA561-1-2- 0.410 or approved equal. All coarse aggregate shall meet the requirements of MCIB section 1 except that it shall meet the following gradation:

Sieve Size	Coarse Aggregate Gradation Limits, % Passing		
	Nominal Maximum Size		
	1"	¾"	½"
1½"	100		
1"	90-97	100	
¾"	62-82	90-97	100
½"	25-60	45-70	80-97
3/8"	16-44	20-55	40-70
No. 4	0-10	0-10	0-15
No. 8	0-5	0-5	0-5

2209 CURBING

2209.3 Paragraph 2209.3 shall be revised to read:

2209.3 **2209.3 Construction Details:** The curbing shall be constructed or reconstructed to the configuration and to the lines and grades shown on the plans. Generally the curbing shall be placed prior to the placement of pavement or sidewalk sections, except when curb and gutter is integral with the pavement.

During concrete placement, if more than 100 cubic yards is to be placed in a single day, the contractor shall supply a water tank to cure all test cylinders in for the first 24 hours after the pour. The tanks shall be of sufficient size to hold three 6"X12" cylinders for every 50 cubic yards poured that day and to allow for the water to maintain a temperature between 60°F and 80°F after being filled with water from the ready mix delivery trucks. The contractor shall be responsible for protecting persons from entering the tanks.

RESOLUTION

Be it resolved by the Director of Public Works of Kansas City, Missouri that the following listed Section of Division II, Construction and Materials Specifications, approved and adopted May 23, 2001 by the Kansas City Metropolitan Chapter of the American Public Works Association is approved and adopted as Official Standard Construction and Materials Specifications for the Department of Public Works of Kansas City, Missouri with like section and page numbers, except as modified by the replacement pages of the March 2005 KCMO Supplement and hereby further modified by the attached supplement.


Section 2200 Construction and Material Specifications for Paving

A copy of said specifications criteria and supplement are attached hereto and incorporated herein by reference.

The criteria shall become effective August 1, 2006 and shall modify all previously adopted supplements to this section.

Approved and adopted as Official Document No. CS070027

this 18th day of July, 2006.

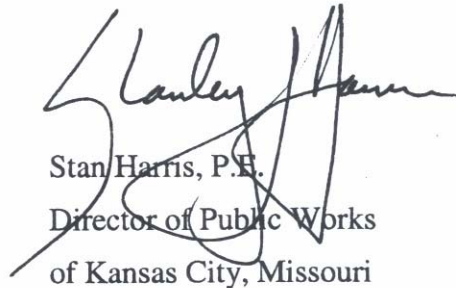

Stan Harris, P.E.
Director of Public Works
of Kansas City, Missouri